


Bathtub Plumbing & Electrical Installation

Power Recommendation

The power control switch (with leakage protection) shall be installed approximately 1000 mm away from the steam chamber or massage bathtub. It must be switched off after each use to ensure safe operation and extend the service life of the control system.

Model: NVB-BT-A206

Size: 1700×790×590

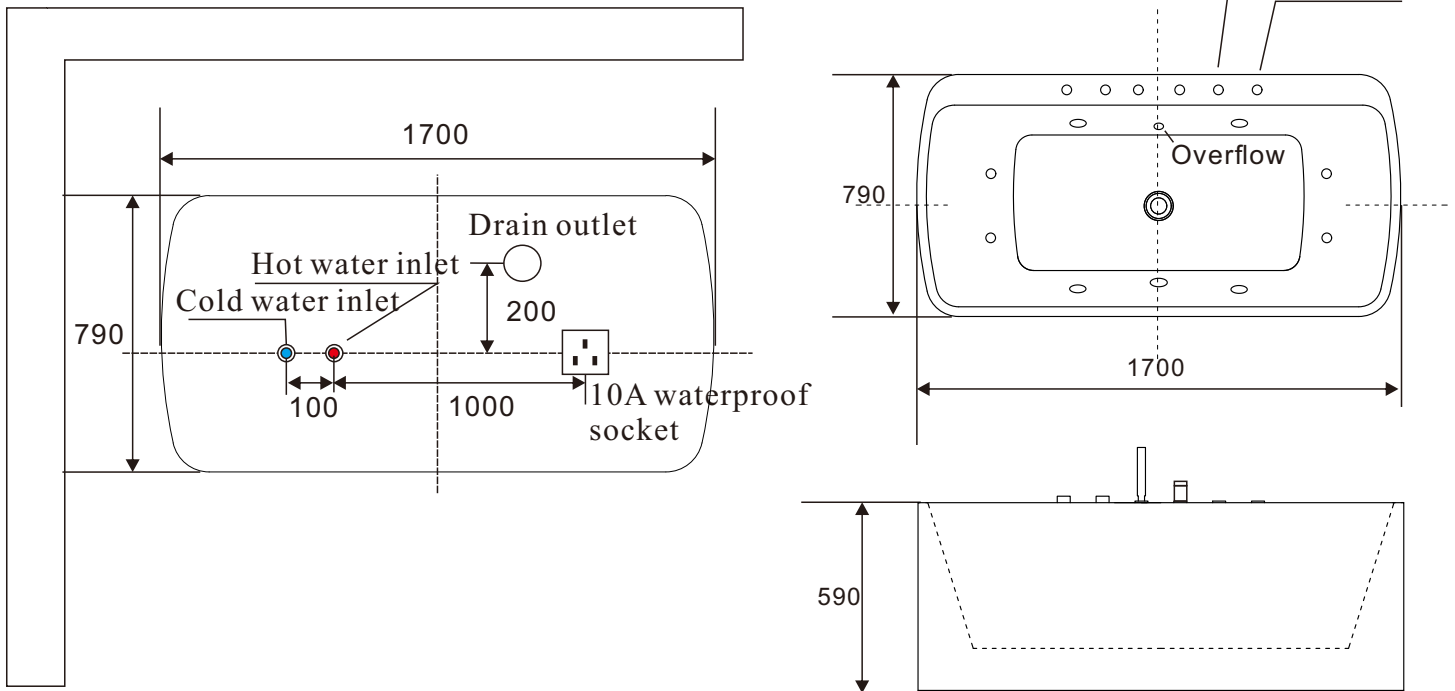

Three dimension erection size drawing

Plane dimension drawing

1. Water Supply Requirements

- *Separate galvanized steel pipes shall be provided for hot water and cold water supply.
- *Wall-mounted shut-off valves shall be installed on each pipeline.
- *Nominal operating water pressure: **0.2 MPa – 0.4 MPa**

2. Power Supply Requirements

- *Rated power: **750W / 220V~, single-phase AC**
- *Wiring: 3-core BV copper cable, **2.5 mm²**
- *Equipped with one **10A waterproof socket**
- *The socket must be fitted with an **independent residual current leakage protection device**
- *The switch and socket shall be installed at an easily accessible position and protected from water splashes